
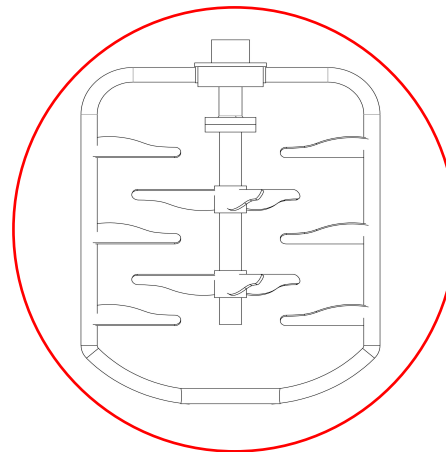
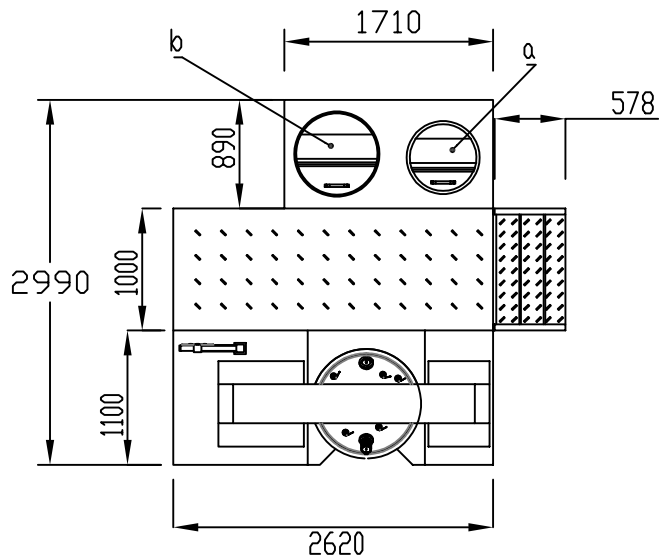


tank cover Schematic diagram

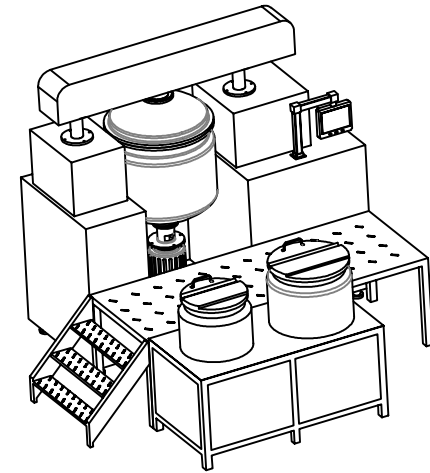

Paddle Schematic diagram

7	spare									
6	Vaccum hole	GMP Standard								
5	LED light									
4	manhole									
3	air filter	GMP Standard								
2	material inlet	GMP Standard								
1	Essence cup	GMP Standard								
	oil tank motor	Siemens, 0.75KW								
	water tanks motor	Siemens, 0.75KW								
i	material outlet	GMP Standard								
h	main tank	300L								
g	Step ladder									
f	Homogeneous motor	5.5KW								
e	top cover	Built-in speed reducer + 3.0KW mixing motor								
d	hydraulic Pole									
c	PLc touch screen	Siemens(chineses&english version)								
b	water tank	design capacity 240L								
a	oil tank	design capacity 150L								
序号	名称									
		300L液压升降真空乳化机								
标记	处数	分区	更改文件号	签名	年月日	阶段	标记	重量	比例	志同®机械
设计	ZJW		标准化							
校核			批准							
审核										
工艺			日期		1109	共张	第张	版本	替代	

零件代号
依(通)用件登记
绘图
描校
旧底图总号
底图总号
签字
日期

Remark :

1. Steam heating Method with temperature sensor for real time monitoring
Steam Heating SS 316L and Power rating with double jacket design to avoid
2. Mixing type : Clockwise and counterclockwise
3. Button panel control with double side welding and 5 batches polishing
4. Internal and External both Hygiene grades polishing as per GMP Standards
5. Mixing Motor Siemens SS316L
6. Welding Mirror Polish 5 times conforming to GMP Standards
7. Control panel buttons to be in English
8. Middle layer in SS316L and thickness conformity standards (No compromises thickness)
9. Material Filter, Pressure Meter, Temperature Sensor required type GMP
10. Frame agitator with Teflon blade in SUS316L
11. All material contact with the product should be in SUS 316L
12. Electric cabinet SUS304 with min thickness 2mm , Mirror finish
13. Temperature control , Bottom Inserted Sanitary type PT100 50-200C
14. Ladder thickness and material of construction SUS304
15. Welding procedure as per GMP